
## ELTL1-DI-AC INSTALLATION


CEILING TO BE PROPERLY REINFORCED TO SUPPORT WEIGHT OF THE FIXTURE.

RISK OF ELECTRICAL SHOCK.
DISCONNECT POWER BEFORE INSTALLATION OR SERVICING.


TO BE INSTALLED BY A QUALIFIED ELECTRICIAN IN NATIONAL ELECTRIC CODES **ACCORDANCE TO LOCAL &** 


INSTALLING AND SERVICING AVOID CONTACT WHEN LEDS ARE EASILY DAMAGED,

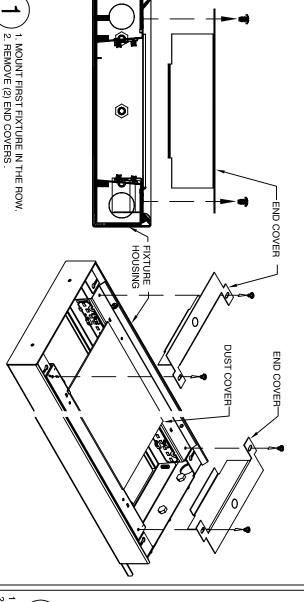

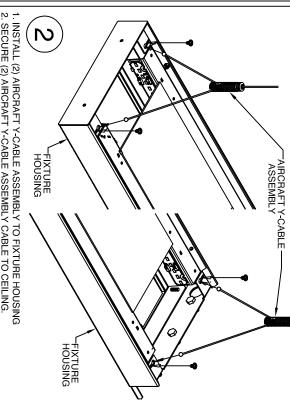

INSTALL (2) AIRCRAFT Y-CABLE ASSEMBLY TO FIXTURE HOUSING
 SECURE (2) AIRCRAFT Y-CABLE ASSEMBLY CABLE TO CEILING.

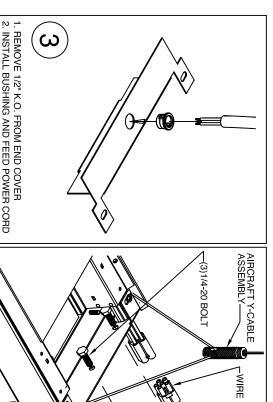

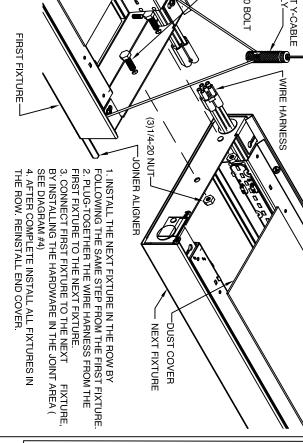


NOT RESPONSIBLE FOR INADEQUATE REINFORCEMENT OF STRUCTURAL SUPPORT SYSTEMS. DAY-O-LITE RESERVES THE RIGHT TO MAKE WITH SIMILAIR INSTALLATION. BE SURE TO UNDERSTAND ALL PROCEDURES PRIOR TO INSTALLATION. IMPORTANT: THE NATIONAL ELECTRIC CODE REQUIRES THAT ANY FIXTURE IN EXCESS OF 50 POUNDS MUST BE INDEPENDENTLY SUPPORTED OF THE OUTLET BOX. DAY-O-LITE IS SPECIFIC, CONSULT SHOP DRAWINGS BEFORE CONSTRUCTING ROWS. STANDARD OPTIONS/SIZES SHOWN, OTHER OPTIONS AVAILABLE ANY MECHANICAL OR MATERIAL CHANGES TO THE FIXTURES WHICH DO NOT AFFECT THE APPEARANCE OR PERFORMANCE. THIS PRINT IS THE PROPERTY OF DAY-O-LITE AND THE INFORMATION IT CONTAINS MAY NOT BE USED WITHOUT WRITTEN CONSENT OF DAY-O-LITE. MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN. DISCONNECT POWER DURING INSTALLATION/SERVICING. ROW CONFIGURATION IS JOB

3. MAKE FEED CONNECTION TO WIRE HARNESS 4. REINSTALL END COVER

4

THROUGH BUSHING

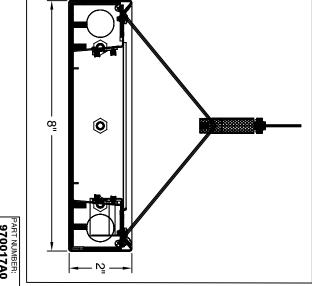

970017A0

Lighting Without Limits

E-mail: sales@dayolite.com WWW: http://www.dayolite.com

Tel. (401) 467-8232 | Fax. (401) 941-2960 126 Chestnut Street, Warwick, RI 02888 CONTACT INFORMATION:

ELTL1-DI---

SHEET 1 OF 1

10/11/19 SSUED ON

MODEL NO