



IMPORTANT THE NATIONAL ELECTRIC CODE REQUIRES THAT ANY FIXTURE IN EXCESS OF 50 POUNDS MUST BE INDEPENDENTLY SUPPORTED OF THE OUTLET BOX. DAY-O-LITE IS NOT RESPONSIBLE FOR INADEQUATE REINFORCEMENT OF STRUCTURAL SUPPORT SYSTEMS.

AFNL RECESSED FIXTURE INSTALLATION
SEE PAGE 2 FOR LENS REMOVAL AND ADJUSTMENT OPTIONS

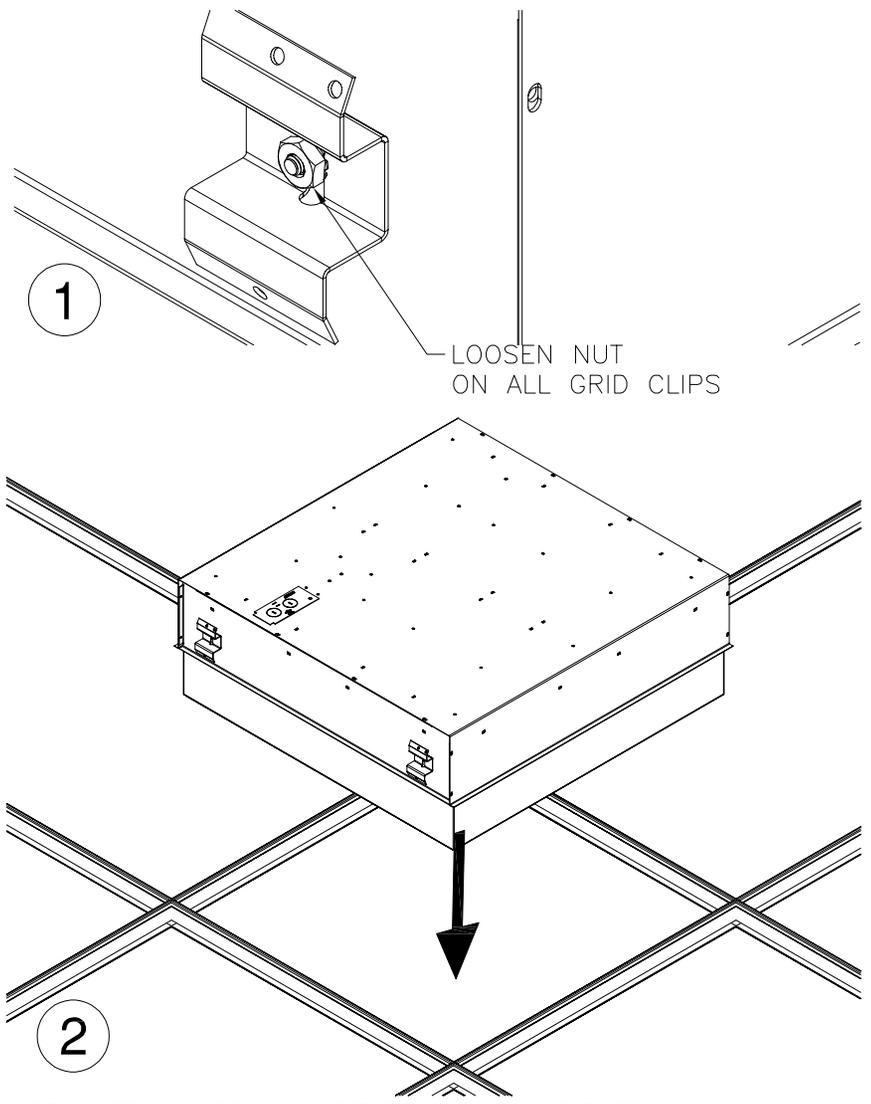

1. LOOSEN NUTS ON GRID CLIPS BEFORE INSTALLING FIXTURE
2. DROP FIXTURE INTO OPENING FROM ABOVE GRID.
3. INSTALL TIE WIRE ON ALL 4 GRID CLIPS AS SHOWN TIE OTHER END TO STRUCTURE TO SUPPORT WEIGHT OF FIXTURE. TIGHTEN NUTS ON GRID CLIPS.
4. REMOVE ACCESS PLATE AND/OR ELECTRICAL KNOCKOUT AS SHOWN AND BRING FEED WIRES INTO FIXTURE AND CONNECT TO LUMINAIRE DISCONNECT
5. REINSTALL ACCESS PLATE AFTER ALL WIRING CONNECTIONS ARE MADE

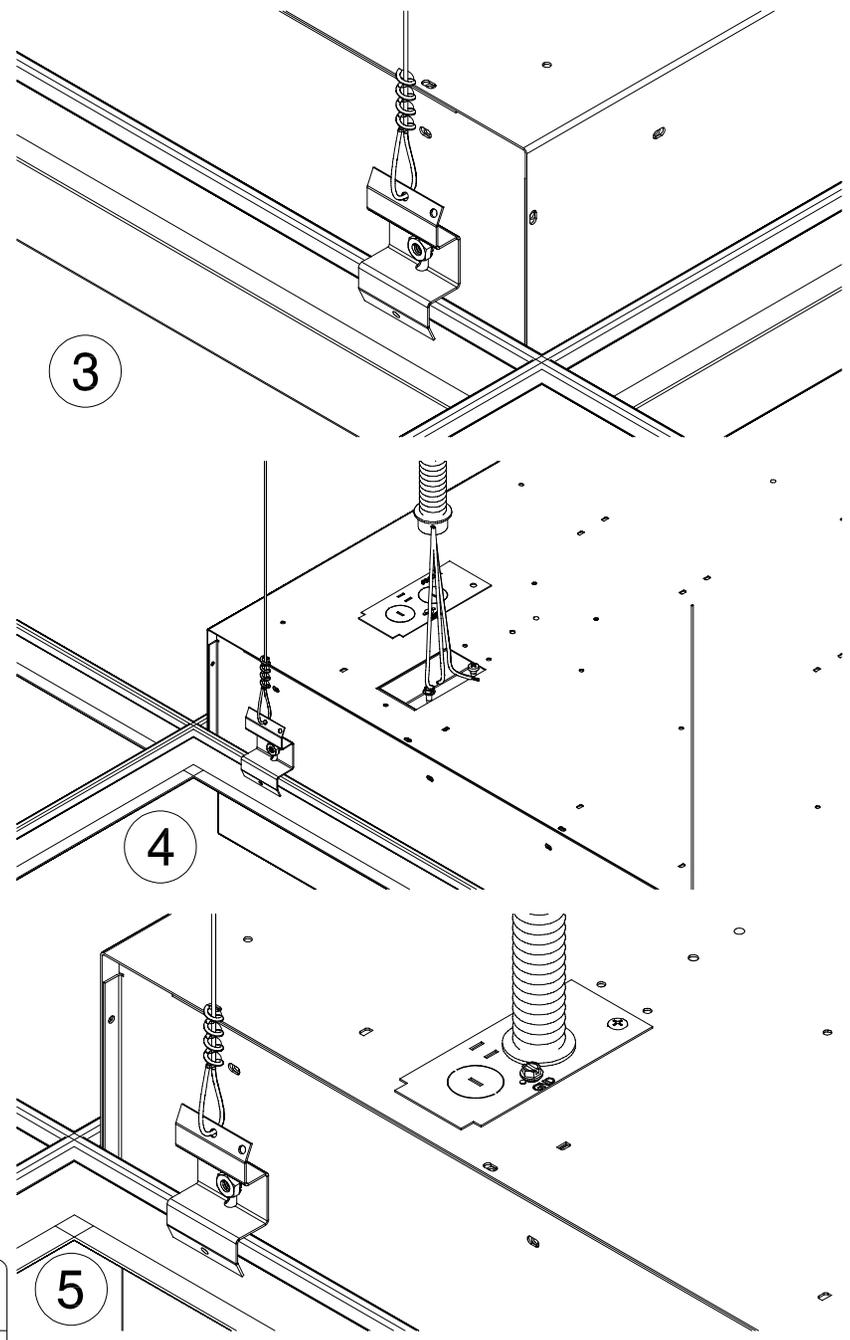

DAY-O-LITE RESERVES THE RIGHT TO MAKE ANY MECHANICAL OR MATERIAL CHANGES TO THE FIXTURES WHICH DO NOT AFFECT THE APPEARANCE OR PERFORMANCE

THIS PRINT IS THE PROPERTY OF DAY-O-LITE AND THE INFORMATION IT CONTAINS MAY NOT BE USED WITHOUT WRITTEN CONSENT OF DAY-O-LITE

BE SURE TO READ AND UNDERSTAND ALL PROCEDURES BEFORE BEGINNING INSTALLATION

IMPORTANT THE NATIONAL ELECTRIC CODE REQUIRES THAT ANY FIXTURE IN EXCESS OF 50 POUNDS MUST BE INDEPENDENTLY SUPPORTED OF THE OUTLET BOX. DAY-O-LITE IS NOT RESPONSIBLE FOR INADEQUATE REINFORCEMENT OF STRUCTURAL SUPPORT SYSTEMS.

AFNL RECESSED FIXTURE INSTALLATION



SHEET 2 OF 2

DAY-O-LITE RESERVES THE RIGHT TO MAKE ANY MECHANICAL OR MATERIAL CHANGES TO THE FIXTURES WHICH DO NOT AFFECT THE APPEARANCE OR PERFORMANCE

THIS PRINT IS THE PROPERTY OF DAY-O-LITE AND THE INFORMATION IT CONTAINS MAY NOT BE USED WITHOUT WRITTEN CONSENT OF DAY-O-LITE

BE SURE TO READ AND UNDERSTAND ALL PROCEDURES BEFORE BEGINNING INSTALLATION

LENS REMOVAL

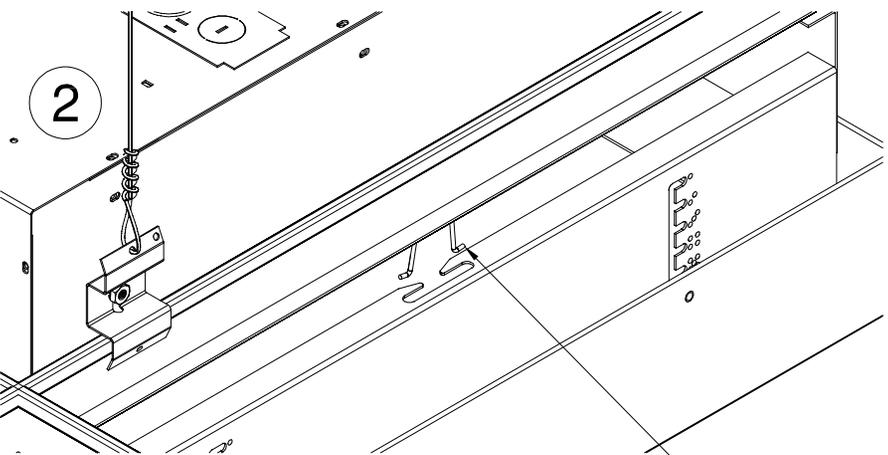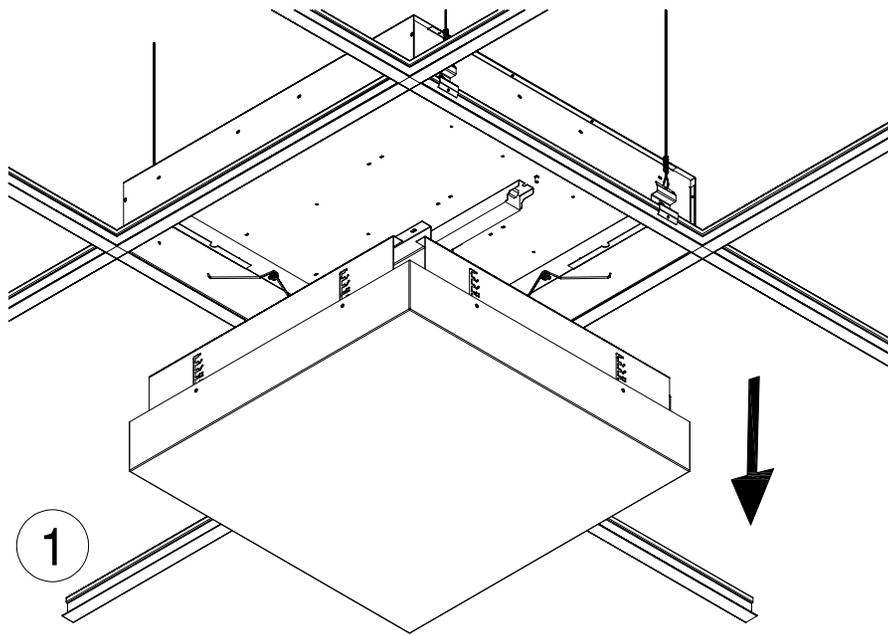




LENS REMOVAL:

- 1) PULL DOWN ON TWO SIDES OF LENS
- 2) SQUEEZE TORSION SPRINGS AND UNHOOK FROM LENS BRACKET

TORSION SPRING
4 PLACES

LENS ADJUSTMENT

LOOSEN NUTS

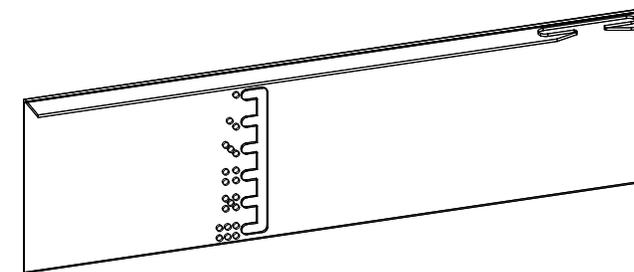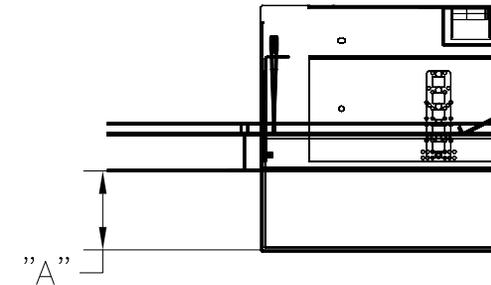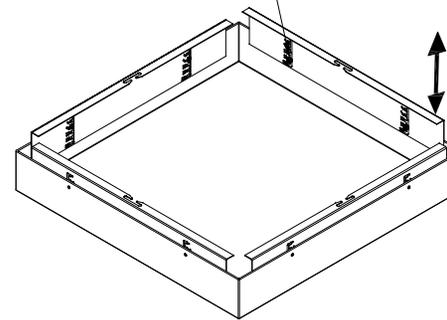

LENS BRACKET POSITION	LENS EXTENSION DIM "A"		
	MODEL		
	AFNL02	AFNL 25	AFNL 57
	0"	2.5"	5"
	.5"	3.0"	5.5"
	1"	3.5"	6"
	1.5"	4"	6.5"
	2"	4.5"	7"
	2.5"	5"	7.5"

*NOTE: FACTORY SETS POSITION AS ORDERED

LENS ADJUSTMENT:

- 1) REMOVE LENS FROM FIXTURE
- 2) LOOSEN THE NUTS SECURING THE BRACKET TO THE LENS
- 3) SLIDE BRACKET TO DESIRED HEIGHT AS INDICATED IN TABLE
- 4) TIGHTEN NUT TO SECURE BRACKET TO LENS
- 5) RE-INSTALL LENS INTO FIXTURE.